

GWF AG

TEST REPORT

SCOPE OF WORK

UL 2043, FIFTH EDITION, DATED SEPTEMBER 14, 2023, FIRE TEST FOR HEAT AND VISIBLE SMOKE RELEASE FOR DISCRETE PRODUCTS AND THEIR ACCESSORIES INSTALLED IN AIR-HANDLING SPACES ON UNICOCODER

REPORT NUMBER

106380832SAT-001C REV1

TEST DATE

11/13/2025

ISSUE DATE **[REVISED DATE]**


11/16/2025 12/19/2025

PAGES

10

DOCUMENT CONTROL NUMBER

GFT-OP-10C (10/03/23)

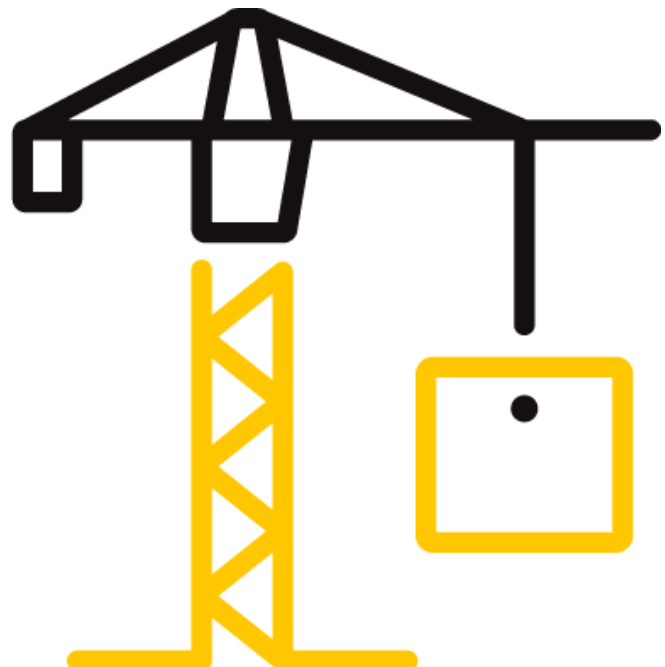

TEST REPORT FOR GWF AG

Report No.: 106380832SAT-001C REV1

Date: 12/19/2025

REPORT ISSUED TO

GWF AG

Obergrundstrasse 119

Luzern, Obergrundstrasse 119 CH-6005

Switzerland

SECTION 1

SCOPE

Intertek Building & Construction (B&C) was contracted by GWF AG, to perform testing in accordance with UL 2043, Fifth Edition, Dated September 14, 2023, Fire test for Heat and Visible Smoke Release for Discrete Products and Their Accessories Installed in Air-Handling Spaces, on their UNICOCODER. Results obtained are tested values and were secured by using the designated test method. The test was conducted at Intertek B&C test facility in Elmendorf, Texas.


Unless differently required, Intertek reports apply the "Simple Acceptance" rule also called "Shared Risk approach," of ILAC-G8:09/2019, Guidelines on Decision Rules and Statements of Conformity.


SECTION 2

SUMMARY OF TEST RESULTS

Test Run	Specimen Model	RESULTS
001C	UNICOCODER	PASSED

For INTERTEK B&C:

COMPLETED BY: Theodore Salazar
TITLE: Technician 3
SIGNATURE: 
DATE: 12/19/2025

REVIEWED BY: Michael Dey
TITLE: Project Engineer
SIGNATURE: 
DATE: 12/19/2025

This report is for the exclusive use of Intertek's Client and is provided pursuant to the agreement between Intertek and its Client. Intertek's responsibility and liability are limited to the terms and conditions of the agreement. Intertek assumes no liability to any party, other than to the Client in accordance with the agreement, for any loss, expense or damage occasioned by the use of this report. Only the Client is authorized to permit copying or distribution of this report and then only in its entirety. Any use of the Intertek name or one of its marks for the sale or advertisement of the tested material, product or service must first be approved in writing by Intertek. The observations and test results in this report are relevant only to the sample(s) tested. This report by itself does not imply that the material, product, or service is or has ever been under an Intertek certification program.

TEST REPORT FOR GWF AG

Report No.: 106380832SAT-001C REV1

Date: 12/19/2025

SECTION 3

TEST METHOD(S)

The specimen was evaluated in accordance with the following:

UL 2043, FIFTH EDITION, DATED SEPTEMBER 14, 2023, FIRE TEST FOR HEAT AND VISIBLE SMOKE RELEASE FOR DISCRETE PRODUCTS AND THEIR ACCESSORIES INSTALLED IN AIR-HANDLING SPACES

This test method is for determining the fire performance response of discrete products (including but not limited to electrical equipment) intended to be installed in air handling spaces, such as above suspended ceilings or below floors. These products are subjected to an open flame ignition source and evaluated using a product calorimeter. The purpose of this test is to determine the rate of heat release and the rate of smoke release of the burning product samples as they relate to the requirements for fire-resistant and low-smoke-producing characteristics in accordance with the provisions of the following codes: National Electric Code, NFPA 70; the International Mechanical Code, NFPA 5000; and the Standard for the Installation of Air Conditioning and Ventilating Systems, NFPA 90A.

SECTION 4

LIST OF OFFICIAL OBSERVERS

NAME	COMPANY
Theodore Salazar	Intertek B&C

SECTION 5

EQUIPMENT

Equipment Type	Equipment No.	Cal. Due Date
Thermo-Hygrometer	19270722	12/26/25
Pressure Transducer	306056763	11/21/25
Data Acquisition System	02LE006	01/31/26
Flowmeter (0-8 SCFM)	63721010006	Ref. Only
Stopwatch	181512641	11/30/25

TEST REPORT FOR GWF AG

Report No.: 106380832SAT-001C REV1

Date: 12/19/2025

SECTION 6

TEST PROCEDURE

All instrumentation was zeroed and calibrated prior to testing. The test specimen, after conditioning to 73°F and 50% R.H., was placed on the specified test frame / enclosure. The 12" x 12" x 4" propane test burner was centered under the specimen, and the test was started. The test specimen is exposed to a direct flame impingement with a heat release rate of 60 kW (92 cubic feet per hour). The test was conducted for 10 minutes at which time the gas burner is shut off.

SECTION 7

TEST SPECIMEN SELECTION AND DESCRIPTION

Sample was submitted to Intertek directly from GWF AG. Sample was not independently selected for testing. Samples, in good condition, were received at the Evaluation Center on 10/27/2025 (SAT2510271251-001)

The specimen consisted of an Singlejet Meter for cold or hot water applications. One specimen was provided.

For additional details, see the data and photographs in this report. See SECTION 10.

SECTION 8

TEST AND OBSERVATIONS RESULTS

Test – Specimen-001C

The specimen was placed in the test enclosure and tested at 2:03 p.m. on November 13, 2025. The ambient temperature was 73°F, with a relative humidity of 52%. The data recorded includes Smoke Release Rate (SRR), Heat Release Rate (HRR). The acceptance criteria data was calculated from these values using the formulas in UL 2043 Section 7. This data may be found in Section 9.

Observations during the test were recorded. The observations are as follows:

TIME (min:sec)	OBSERVATION
0:00	The 60-kW propane burner was ignited.
0:29	The plastic cover began to melt.
10:00	The propane burner was turned off. Test Terminated.

TEST REPORT FOR GWF AG

Report No.: 106380832SAT-001C REV1

Date: 12/19/2025

SECTION 9

EVALUATION RESULTS AND CONCLUSION

ITEM	RESULTS
Peak rate of heat release (HRRs)	6 kW
Peak rate of smoke release (SRRs)	0.04 m ² /s
Total smoke released for first 10 minutes (TSR)	1 m ²
Peak normalized optical density*	0.10
Average normalized optical density (for first 10 minutes 10 min) *	0.00
Results	Passed

(*Informational data only, not used for acceptance criteria)

ACCEPTANCE CRITERIA

1. The peak rate of heat release (HRRs) measured during each test shall be 100 kilowatts or less.
2. The peak smoke release rate measured during each test shall be 0.21 m²/s or less, SRRs.
3. The total smoke release (10-minute test duration) shall be 75 m² or less, TSR.

Intertek Testing Services NA (Intertek) has conducted testing for GWF AG, on the UNICOCODER to evaluate heat and smoke release. Testing was conducted in accordance with UL 2043, Fifth Edition, Dated September 14, 2023, Fire test for Heat and Visible Smoke Release for Discrete Products and Their Accessories Installed in Air-Handling Spaces. The specimen tested met the requirements of this test method.

The conclusions of this test report may not be used as part of the requirements for Intertek product certification. Authority to Mark must be issued for a product to become certified.



TEST REPORT FOR GWF AG

Report No.: 106380832SAT-001C REV1

Date: 12/19/2025

SECTION 10


TEST DATA AND PHOTOGRAPHS

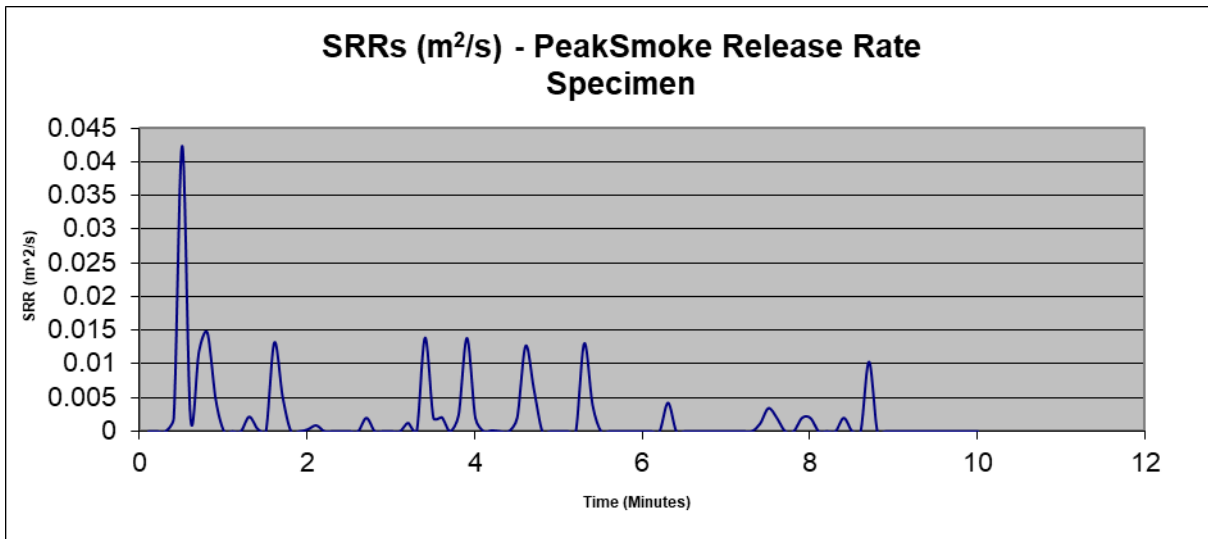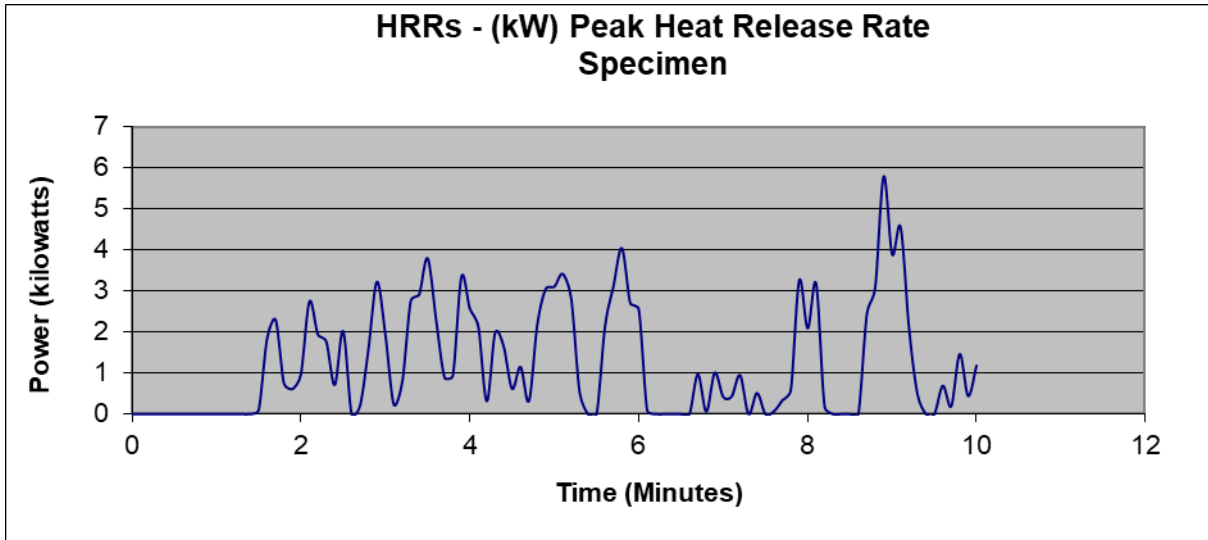

TEST REPORT FOR GWF AG

Report No.: 106380832SAT-001C REV1

Date: 12/19/2025

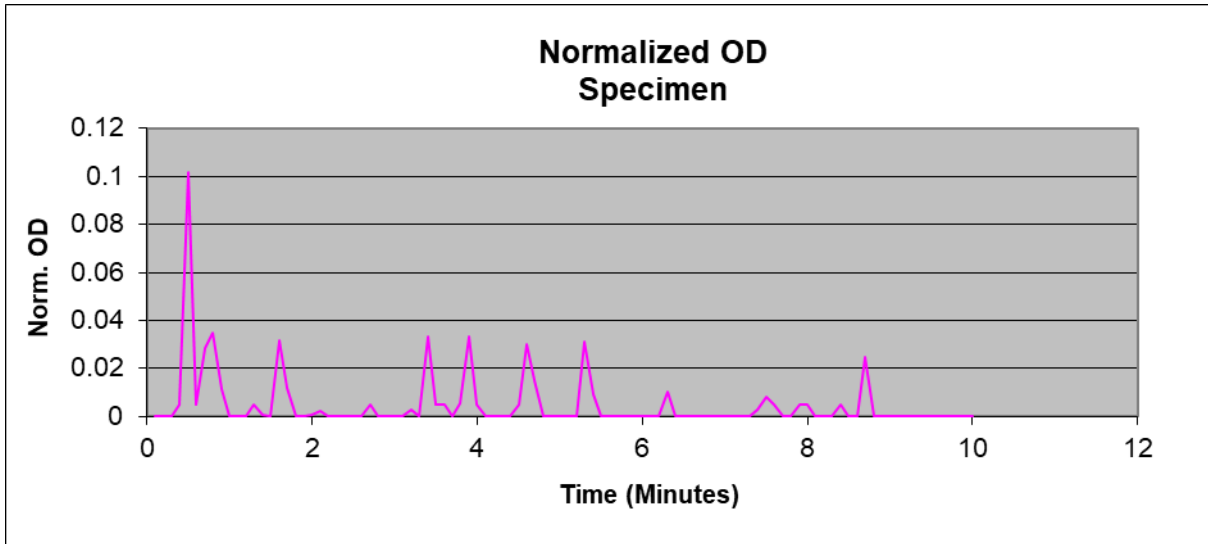

Pre-test photo

TEST REPORT FOR GWF AG

Report No.: 106380832SAT-001C REV1

Date: 12/19/2025



Pre-test photo



Test photo

TEST REPORT FOR GWF AG

Report No.: 106380832SAT-001C REV1

Date: 12/19/2025



Post-test photo



Post-test photo



Total Quality. Assured.

16015 Shady Falls Road
Elmendorf, Texas 78112

Telephone: 210-635-8100
Facsimile: 210-635-8101
www.intertek.com/building

TEST REPORT FOR GWF AG

Report No.: 106380832SAT-001C REV1

Date: 12/19/2025

SECTION 11
REVISION LOG

REVISION #	DATE	PAGES	REVISION
0	11/16/2025	N/A	Original Report Issue
1	12/19/2025	1-2 & 5	Sample ID changed, requested by the client. <i>Mark Day</i>